

Butterball®

BB-SC SERIES AND "LEAD FREE"
UPBBTSC SERIES



FIRE SPRINKLER SYSTEM

SLO-CLOSE, INDICATING
BUTTERFLY VALVES RATED
FOR INDOOR & OUTDOOR AND
POTABLE WATER SYSTEMS



INNOVATION IN EVERY VALVE




MILWAUKEE VALVE

REV. 11/17

SPECIFICATIONS FOR SLO-CLOSE

ALL PATENTED SLO-CLOSE BUTTERBALL VALVES...

- provide slow opening and closing properties in a quarter-turn valve. The purpose is to eliminate hydraulic shock and water hammer in fire protection and other liquid systems.
- are available with or without an internal, pre-wired supervisory tamper switch assembly. When mounted on any slo-close valve and wired, the switches signal movement of the valve disc from the full open position.
- are available factory mounted to a valve or as a kit for field installation on previously installed valves.
- have switch ratings of:
10 Amps/115 VAC-60 Hz
0.5 Amps/28 VDC
- are equipped with tamper switch assemblies FOR INDOOR AND OUTDOOR USE.
- have UL/FM ratings to 175 psi. (Also available at 350 psi with N.Y.C.B.S.A. approval.)

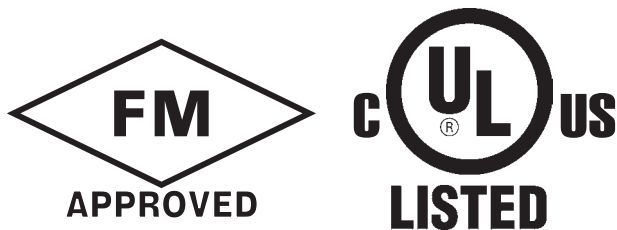

For use with fire protection sprinkler systems 175psi.

Approved by the New York City Board of Stds. & Appeals under Calendar No. 996-81 -SM, for 175 psi and Calendar number 720-83-SA for 350 psi.

BUTTERBALL SLO-CLOSE INSTALLATION (BB-SC)

- The BBSC can be installed in any orientation in a piping system using standard National Pipe Threads. Wrench should be used to hex on the end of valve being threaded to pipe. Pipe sealants should be used sparingly.
- The valves with internal switches can be easily wired in the field. They will have two switches, switch-1 will have dual leads on the terminals. This switch is to be connected to the **supervisory** circuit of a Listed alarm control panel. Switch-2 will have single leads and may be connected to **auxiliary** equipment per direction of the local authority having jurisdiction. Cap any unused wire leads with wire nuts and tuck into junction box. All connections shall be reviewed and approved by the local authority having jurisdiction.
- A 14 gage green wire has been fastened to the interior of the housing and is to be used as a housing ground.
- Recommended type of wire to be used is No.16 Dual Rated UL 300V 80 C and 300V 105 C.
- Installation must be in compliance with NFPA 72 and 13, or bonded and grounded per Canadian Electrical Code Part 1.
- The BB-SC, BBHSC (threaded-end) and BBVSC, BVHSC (grooved-end) valves are intended for use with schedule 40 and/or 80 pipe, sizes 1", 1-1/4", 1-1/2", 2" and 2-1/2" per ASME/ANSI B36.10.

INSTALLATION FOR NEW YORK CITY VALVES

N.Y.C. special valves have a large flow indicator which points in the direction of the valve disc, indicating open or closed. The valve should be installed in a position where the indicator is readily visible.


MODEL	DESCRIPTION	SIZES
BB-SC100	Valve Less Switch	175 psig - Threaded Ends
BB-SCS02	Valve With Switch	NYC BSA Approved
BBVSC100	Valve Less Switch	175 psig - Grooved Ends
BBVSCS02	Valve With Switch	NYC BSA Approved
BBHSC100	Valve Less Switch	350 psig - Threaded Ends
BBHSCS02	Valve With Switch	NYC BSA Approved
BVHSC100	Valve Less Switch	350 psig - Grooved Ends
BVHSCS02	Valve With Switch	NYC BSA Approved

The information presented on this sheet is correct at the time of publication. Milwaukee Valve reserves the right to change design, and/or material specifications without notice. For the Installation, Operation and Maintenance Manual (IOM) see the engineering section on our website. For the most current information access www.milwaukeevalve.com




Butterball® BUTTERFLY VALVES

VALVE ASSEMBLY 175 PSI


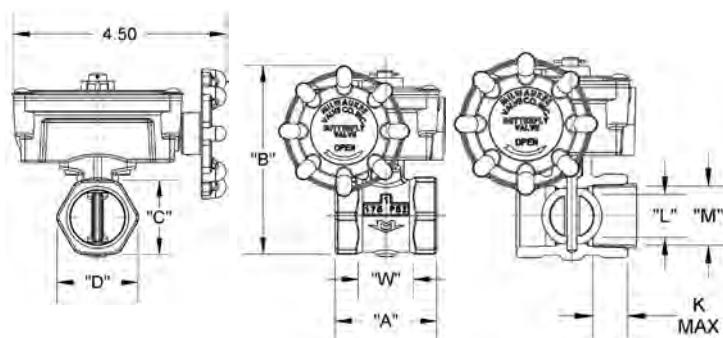


BB-SC100 and BBSCS-02 (Threaded Ends)
Sizes 1", 1-1/4", 1-1/2", 2", 2-1/2"

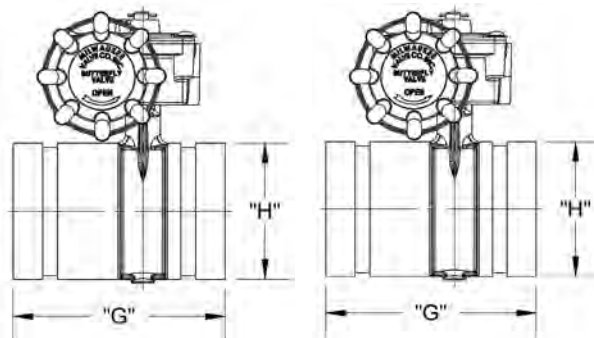

BBVSC100 and BBVSCS02 3 piece with Grooved Ends Size 2"

BBVSC100 and BBVSCS02 Uni-body with Grooved Ends Size 2-1/2"

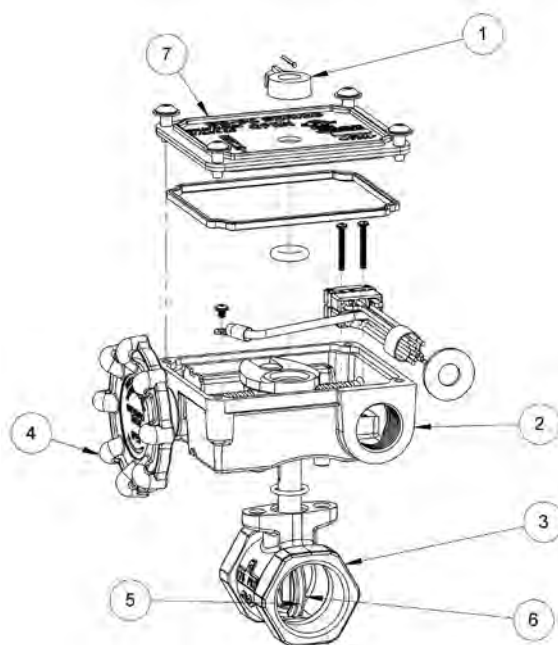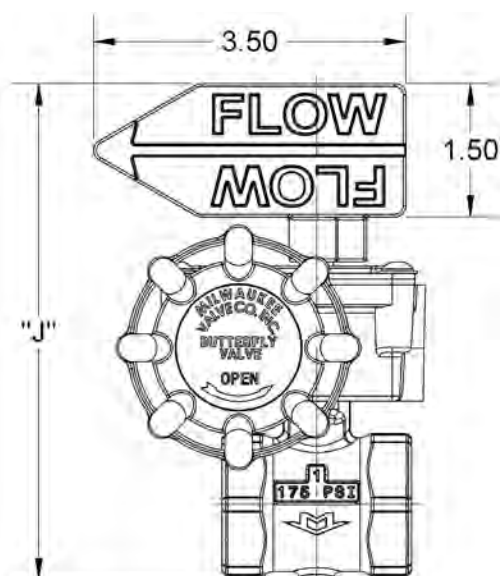

ALL DIMENSIONS-INCHES								
	THREADED					GROOVED		
SIZE	1"	1-1/4"	1-1/2"	2"	SIZE	2"	2-1/2"	
A	2.13	2.63	2.88	3.25	A	-	4.13	
B	3.94	4.28	4.50	5.00	B	5.00	5.41	
C	1.56	1.94	2.19	2.75	C	2.75	3.19	
D	1.72	2.11	2.38	3.06	D	3.06	3.50	
J	5.55	5.91	8.18	6.67	E	0.63	0.31	
K	0.66	0.73	0.73	0.79	F	0.63	0.63	
L	0.83	0.90	0.99	1.41	G	6.00	4.50	
M-40	1.05	1.38	1.61	2.07	H	2.38	2.89	
M-80	0.96	1.28	1.50	1.94	J	6.13	6.25	
N-40	2.25	2.00	2.50	2.25	K	0.79	1.18	
W	1.13	1.25	1.41	1.69	L	1.41	1.29	
					M-40	2.07	2.47	
					M-80	1.94	2.32	
					N-40	2.25	10.00	
					W	-	1.75	

M-40 ARE DIMENSIONS USING SCHEDULE 40 PIPE
M-80 ARE DIMENSIONS USING SCHEDULE 80 PIPE
N-40 IS FLOW RESISTANCE EXPRESSED IN EQUIVALENT LENGTH OF SCHEDULE 40 PIPE
W IS THE WRENCH MAKE-UP LENGTH

MATERIAL LIST


NO.	PART	MATERIAL	SPECIFICATION
1	Indicator	Sintered Iron	F0008P
2	Housing	Bronze	ASTM B584
3	Body	Bronze	ASTM B584
4	Handle	Brass	
5	Disc	Stainless Steel	Type 304
6	Disc Seal	EPDM Elastomer	
7	Cover	Bronze	ASTM B584

The information presented on this sheet is correct at the time of publication. Milwaukee Valve reserves the right to change design, and/or material specifications without notice. For the Installation, Operation and Maintenance Manual (IOM) see the engineering section on our website. For the most current information access www.milwaukeevalve.com




Butterball[®] BUTTERFLY VALVES

VALVE ASSEMBLY 350 PSI


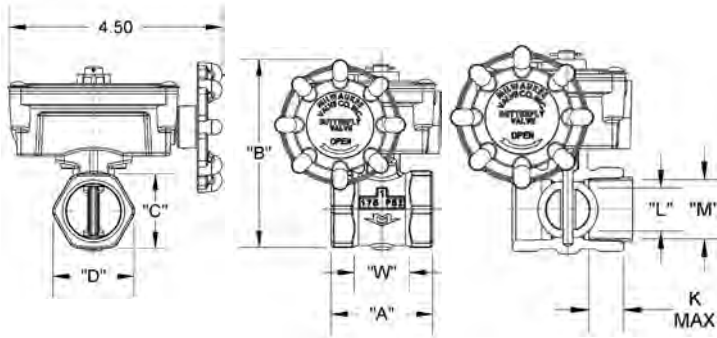


BB-SC100 and BBSCS-02 (Threaded Ends)
Sizes 1", 1-1/4", 1-1/2", 2", 2-1/2"

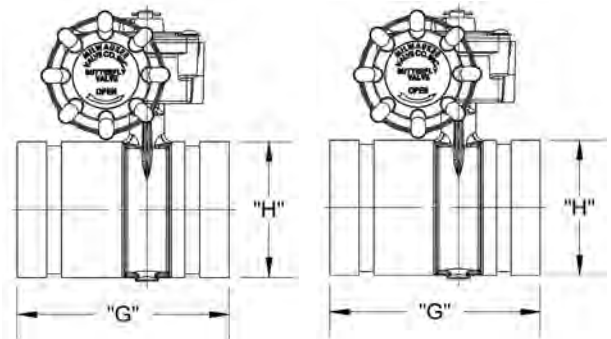

**BBVHSC100 and
 BBVHS02 3 piece
 with Grooved
 Ends Size 2"**

**BBVHSC100 and
 BBVHS02 Uni-Body
 with Grooved
 Ends Size 2-1/2"**

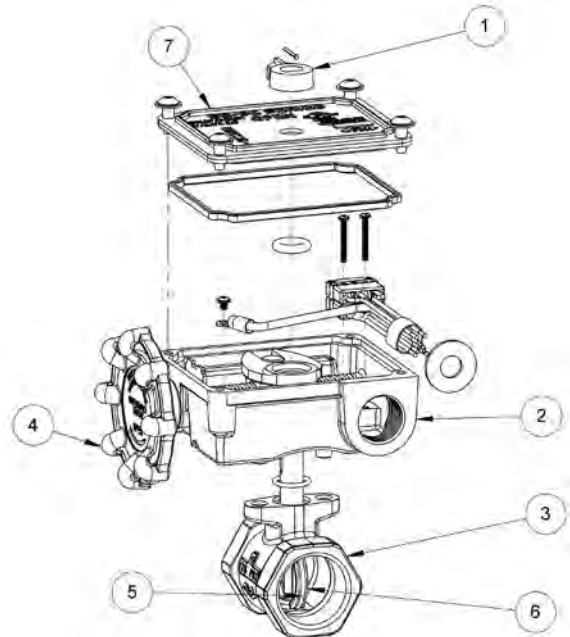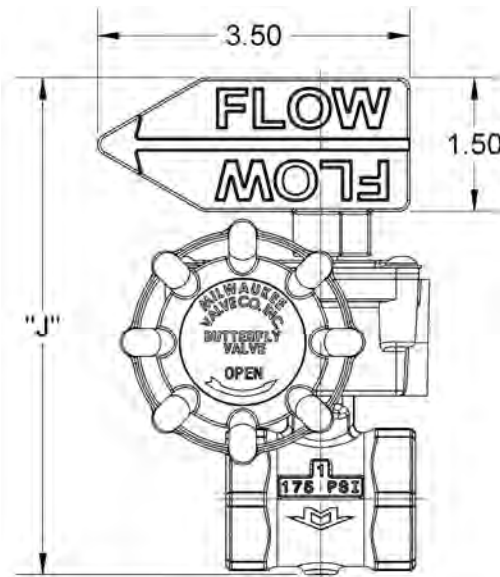

ALL DIMENSIONS-INCHES								
THREADED					GROOVED			
SIZE	1"	1-1/4"	1-1/2"	2"	SIZE	2"	2-1/2"	
A	2.13	2.63	2.88	3.25	A	-	4.13	
B	3.94	4.28	4.50	5.00	B	5.00	5.41	
C	1.56	1.94	2.19	2.75	C	2.75	3.19	
D	1.72	2.11	2.38	3.06	D	3.06	3.50	
J	5.55	5.91	8.18	6.67	E	0.63	0.31	
K	0.66	0.73	0.73	0.79	F	0.63	0.63	
L	0.83	0.90	0.99	1.41	G	6.00	4.50	
M-40	1.05	1.38	1.61	2.07	H	2.38	2.89	
M-80	0.96	1.28	1.50	1.94	J	6.13	6.25	
N-40	2.25	2.00	2.50	2.25	K	0.79	1.18	
W	1.13	1.25	1.41	1.69	L	1.41	1.29	
					M-40	2.07	2.47	
					M-80	1.94	2.32	
					N-40	2.25	10.00	
					W	-	1.75	

M-40 ARE DIMENSIONS USING
 SCHEDULE 40 PIPE
M-80 ARE DIMENSIONS USING
 SCHEDULE 80 PIPE
N-40 IS FLOW RESISTANCE
 EXPRESSED IN EQUIVALENT LENGTH OF
 SCHEDULE 40 PIPE
W IS THE WRENCH MAKE-UP LENGTH

MATERIAL LIST

NO.	PART	MATERIAL	SPECIFICATION
1	Indicator	Sintered Iron	F0008P
2	Housing	Bronze	ASTM B584
3	Body	Bronze	ASTM B584
4	Handle	Brass	
5	Disc	Stainless Steel	Type 304
6	Disc Seal	EPDM Elastomer	
7	Cover	Bronze	ASTM B584

The information presented on this sheet is correct at the time of publication. Milwaukee Valve reserves the right to change design, and/or material specifications without notice. For the Installation, Operation and Maintenance Manual (IOM) see the engineering section on our website. For the most current information access www.milwaukeevalve.com



UPBBTSCSCL/UPBBTSCS02L 1"-2"



Tested and Certified by
ANSI/ISO 9001:2015 (Level 2)
for lead-free compliance



MATERIAL LIST

ITEM	PART	MATERIAL	ASTM SPEC
1	Indicator	Sintered Iron	F0008P
2	Housing	Bronze	ASTM 584
3	Body	Bronze	ASTM 584
4	Handle	Brass	
5	Disc	Stainless Steel	Type 304
6	Disc Seal	EPDM	
7	Cover	Die Cast Aluminum	

ALL DIMENSIONS-INCHES

SIZE	1"	1-1/4"	1-1/2"	2"
A	2.13	2.63	2.88	3.25
B	3.94	4.28	4.5	5
C	1.56	1.94	2.19	2.75
D	1.72	2.11	2.38	3.07
K	0.66	0.73	0.73	0.79
L	0.83	0.9	0.1	1.41
M-40	1.1	1.38	1.61	2.07
M-80	0.96	1.28	1.5	1.94
N-40	2.25	2	2.5	2.25
W	1.13	1.25	1.41	1.69

M-40 ARE DIMENSIONS USING
SCHEDULE 40 PIPE



M-80 ARE DIMENSIONS USING
SCHEDULE 80 PIPE

N-40 IS FLOW RESISTANCE
EXPRESSED IN EQUIVALENT LENGTH OF
SCHEDULE 40 PIPE

W IS THE WRENCH MAKE-UP LENGTH

FEATURES

- Slow opening and closing
- Quarter turn operation
- Water Hammer elimination
- Optional internal tamper switch
(Indoor/Outdoor use).
 - Signals disc movement
 - Factory or Field installation
 - 10 Amp / 115 VAC-60 Hz
 - 0.5 Amp / 28 VDC

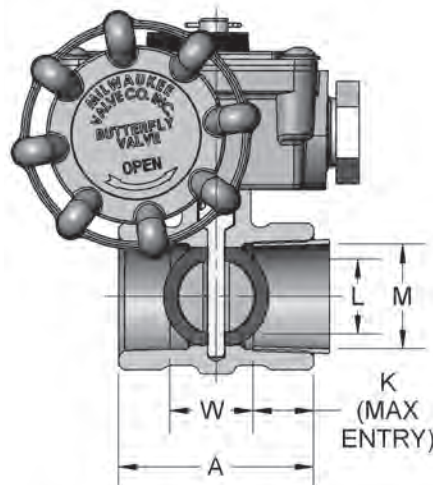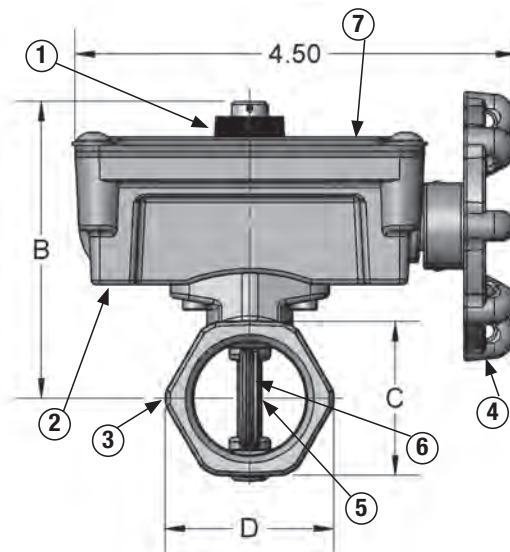

UPBBTSCSCL
SIZES 1", 1-1/4", 1-1/2", 2"

UPBBTSCS02L
(INCLUDES SWITCH)
SIZES 1", 1-1/4", 1-1/2", 2"

Note: Lead free refers to the wetted surface of the pipe, fittings and fixtures in potable water systems that have a weighted average lead content $\leq 0.25\%$. Source: California Health and Safety Code (116875).


The information presented on this sheet is correct at the time of publication. Milwaukee Valve reserves the right to change design, and/or material specifications without notice. For the Installation, Operation and Maintenance Manual (IOM) see the engineering section on our website. For the most current information access www.milwaukeevalve.com




WIRING DIAGRAM

(SWITCH POSITION VALVE FULL OPEN)

SWITCH 1: DUAL LEADS

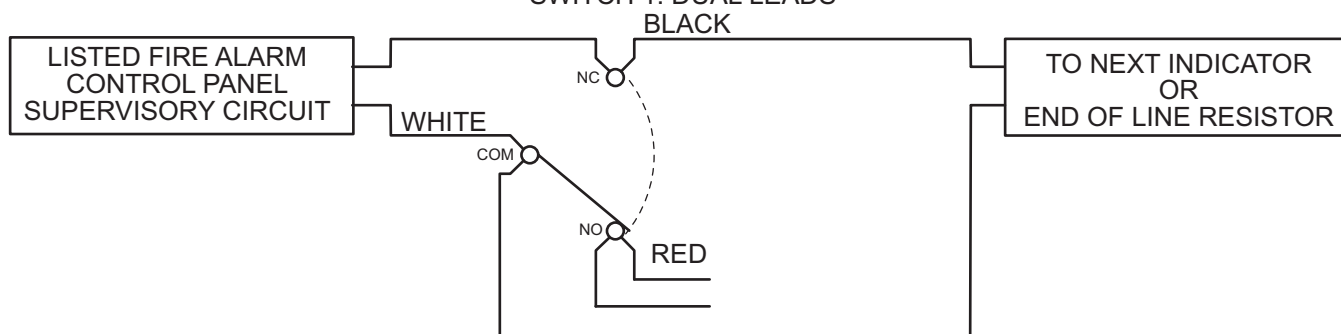

SWITCH 2: SINGLE LEADS

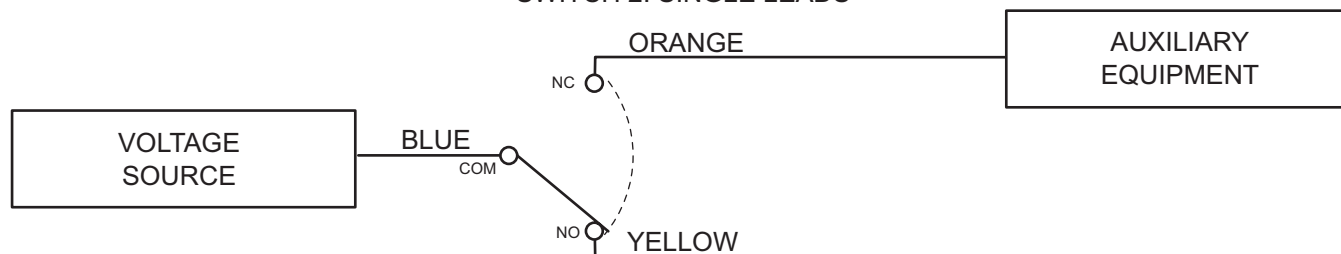


Green Lead provided is ground for switch housing

Switch Rating: 10 AMP/115 VAC

.5 AMP/28 VDC

Cap unused leads with wire nuts and tuck inside junction box (not provided)

NOTE: Valves incorporating supervisory tamper switches are for **indoor and outdoor use.**

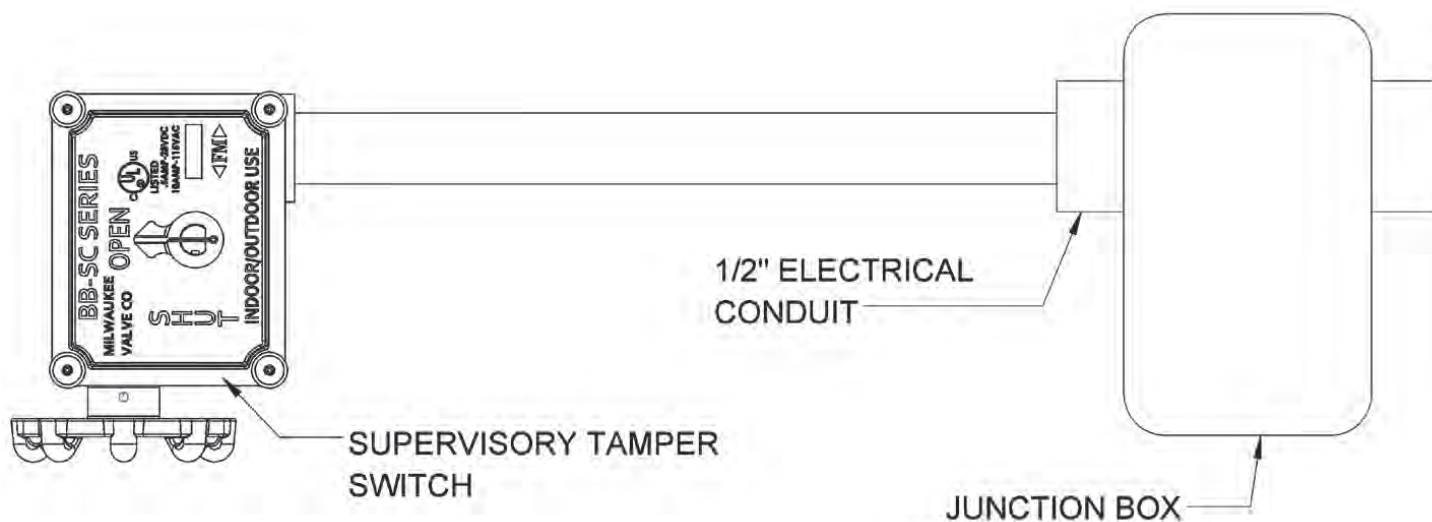

The information presented on this sheet is correct at the time of publication. Milwaukee Valve reserves the right to change design, and/or material specifications without notice. For the Installation, Operation and Maintenance Manual (IOM) see the engineering section on our website. For the most current information access www.milwaukeevalve.com

